

1 PARTIAL PENTHOUSE & ROOF PLAN - POWER
E109 SCALE 1/4"=1'-0"

GENERAL NOTES	
1.	CONTROL WIRING TO NEW SMOKE CONTROL PANEL ON THE P1 LEVEL IS NOT SHOWN BUT SHALL BE RUN IN SEPARATE CONDUIT FROM OTHER WIRING.
2.	HEAT DETECTORS SHALL SHUT DOWN POWER TO THE ELEVATOR FROM POWER TO THE ELEVATOR TO THE FIRE ALARM CONTROL PANEL.


KEY NOTES	
①	UNMOUNT NEW PANEL, TRIM WITHIN 6" OF JOIST.
②	CONNECT DUCT DETECTORS TO NEAREST NOTIFICATION CIRCUIT.
③	EXISTING FIRE ALARM ELEVATOR RECALL RELAYS.
④	15% DEGREE RATED HEAT DETECTORS TO SHUNT POWER TO ELEVATORS UPON DETECTION OF SMOKE IN EACH ELEVATOR MACHINE ROOM.
⑤	NEW REBAR'S PHONE JACK, TYPICAL FIRST FLOOR.
⑥	RELOCATE LIGHT FIXTURE BRANCH CIRCUIT TO AVOID NEW DUCT.

114 EAST 20th AVENUE, SUITE 400, TAMPA, FL 33601
 www.h2engineering.com

HEP PROJECT No. 1109

THIS DOCUMENT IS THE PROPERTY OF H2ENGINEERING AND SHALL BE RETURNED TO THE OFFICE OF ORIGIN UPON REQUEST. EXCEPT BY WRITTEN PERMISSION OF H2ENGINEERING.

Florida Certificate of Professional Engineering #27265
 Peter C. Lindstrom, P.E. #47098

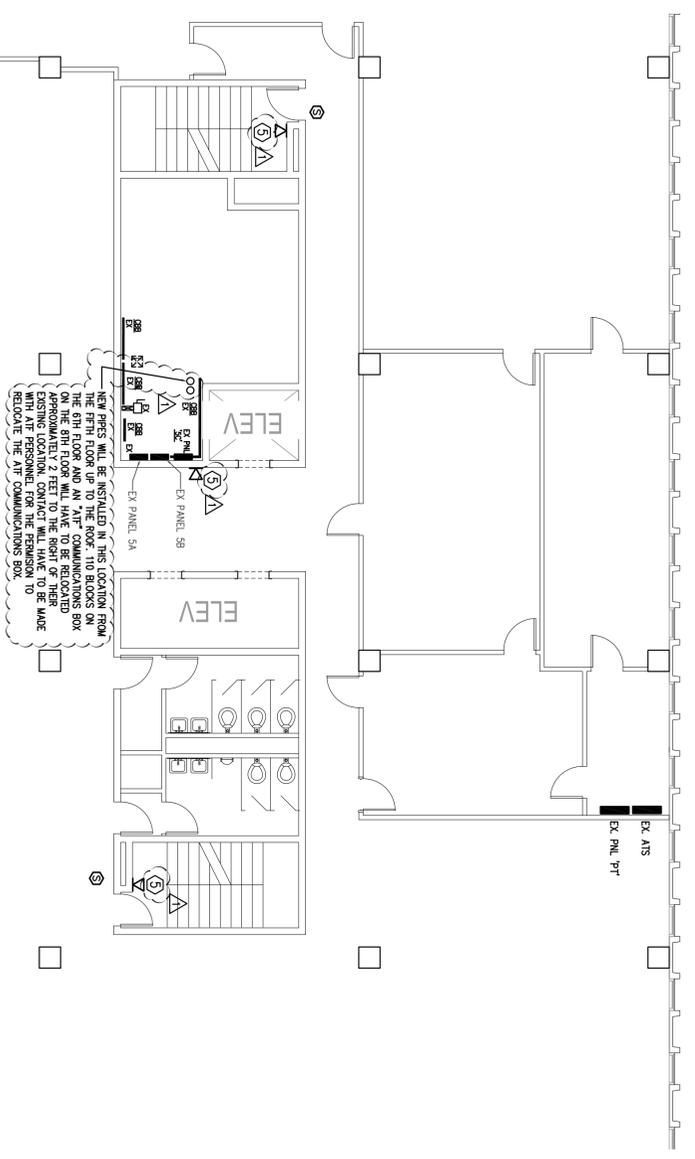

2 5TH FLOOR PARTIAL PLAN - POWER
E109 SCALE 1/8"=1'-0"

NEW PNL'S WILL BE INSTALLED IN THIS LOCATION FROM THE 8TH FLOOR AND AN AT COMMUNICATIONS BOX APPROXIMATELY 2 FEET TO THE RIGHT OF THEIR EXISTING LOCATION. THE PERSONS TO BE MAINTAINED WITH THE PERSONS FOR THE PERSONS TO BE MAINTAINED RELOCATE THE AT COMMUNICATIONS BOX.

**BARNETT
FRONCZAK
BARLOWE
ARCHITECTS**


Leon County
 Courthouse Annex
 (Bank of America) Stair
 & Elevator
 Pressurization

Drawn By: T.2082
 Checked By: _____
 Project Code: _____
 Date: 27 April 2012


Construction Documents

Revisions
 5 JUNE 2012 - ADDENDUM #1

**PARTIAL FLOOR PLANS
 - ELECTRICAL**

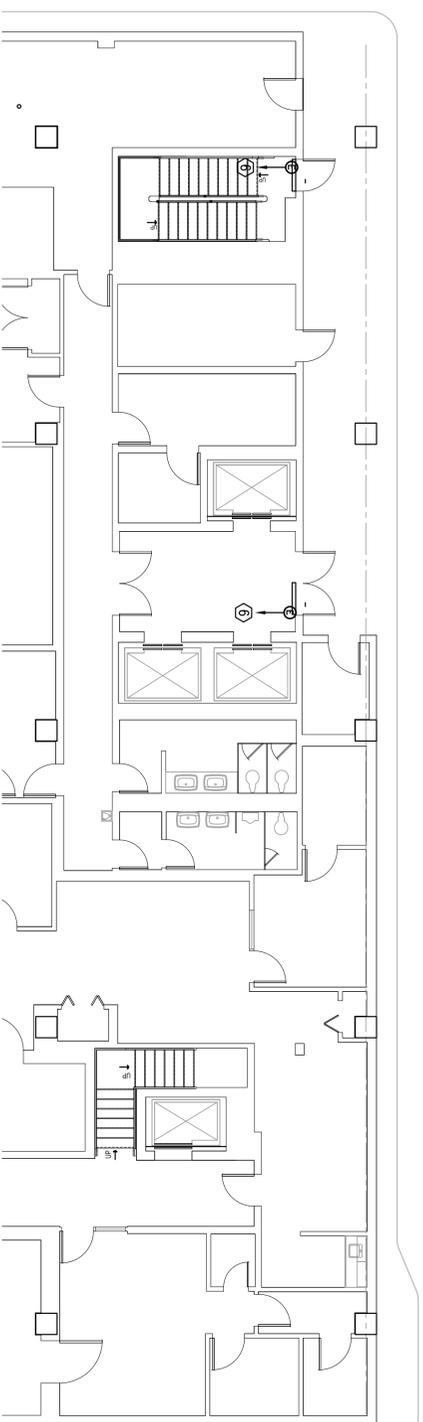

1 PARKING LEVEL P-2 - PARTIAL PLAN - POWER
E110 SCALE 1/8"=1'-0"

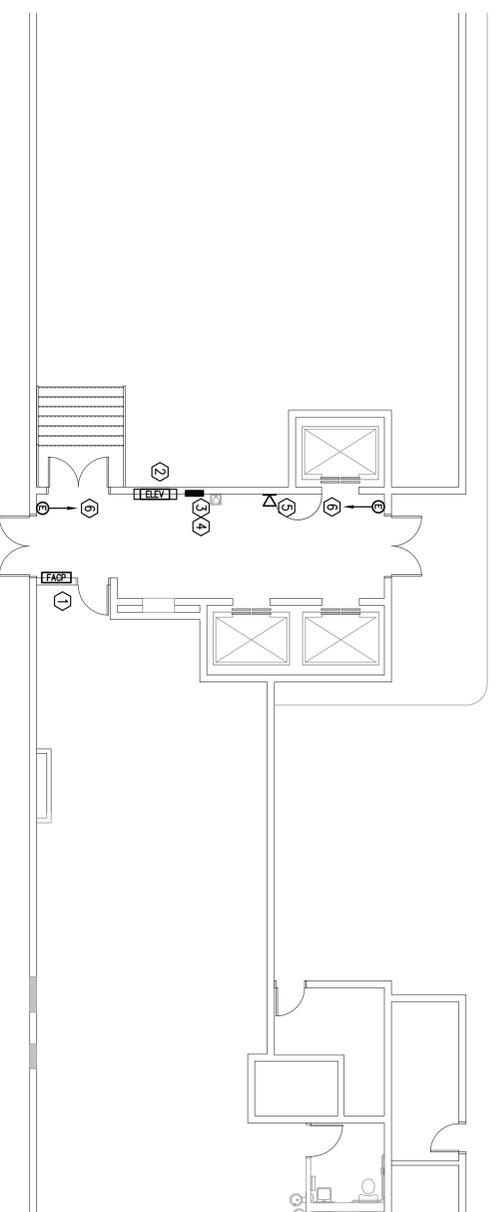

1 PARKING LEVEL P-1 - PARTIAL PLAN - POWER
E110 SCALE 1/8"=1'-0"



GENERAL NOTES

1. CONTROL WIRING TO NEW SMOKE CONTROL PANEL ON THE P1 LEVEL IS NOT SHOWN BUT SHALL BE RUN IN SEPARATE CONDUIT FROM OTHER WIRING.
2. HEAT DETECTORS SHALL SHUT DOWN POWER TO THE ELEVATOR ENCLOSURE AND BE WIRING TO THE FIRE ALARM CONTROL PANEL.

KEY NOTES

- ① EXISTING FIRE ALARM CONTROL/VOICE PANEL. (SAMPLE 41000)
- ② EXISTING FIREMAN'S ELEVATOR MONITOR AND CONTROL PANEL
- ③ NEW SMOKE CONTROL PANEL
- ④ STANWELL FANS REMOTE FIREMAN'S CONTROL ROOM STATUS REQUIREMENTS OF THE FBC 909.16.2 AND UL 864.
- ⑤ NEW FIREMAN'S PHONE JACK TYPICAL EACH FLOOR.
- ⑥ CIRCUIT POWER TO NEW 20A, 1P BREAKER FROM MAIN PANEL CONTROLS TO FIRE ALARM PANEL.

112 ENGINEERING

114 EAST 20th AVENUE, TALLAHASSEE, FL 32301
www.112engineering.com

THIS DOCUMENT IS THE PROPERTY OF 112 ENGINEERING AND SHOULD BE RETURNED TO THE OFFICE OF ORIGIN. ANY REPRODUCTION OF THIS DOCUMENT WITHOUT THE WRITTEN PERMISSION OF 112 ENGINEERING IS PROHIBITED.
Florida Certificate of Professional Engineering #27265
Peter C. Underwood, P.E. #47098

BARNETT FRONCZAK BARLOWE ARCHITECTS

Leon County
Courthouse Annex
(Bank of America) Stair
& Elevator
Pressurization

Drawn By: T.2082
Checked By: _____
Project Code: _____
Date: 27 April 2012

Construction Documents

- Revisions
- △ 5 JUNE 2012 - ADDENDUM #1
 - △
 - △
 - △
 - △

**PARTIAL FLOOR PLANS
PARKING LEVELS P-1 & P-2 -
ELECTRICAL**

ADDENDUM #1 - NEW SHEET

Tallahassee, Florida
E110

