



PROFILE NOTES:
 1. EXISTING AND NEW WATER MAIN PROFILES ARE NOT SHOWN.
 2. NEW WATER MAINS SHALL PARALLEL THE NEW PROFILE OF THE ROADWAY AT THE DEPTHS OF 3 FT. TO 6 FT. FROM FINISHED PROFILE GRADE TO THE CROWN OF THE NEW PIPE.

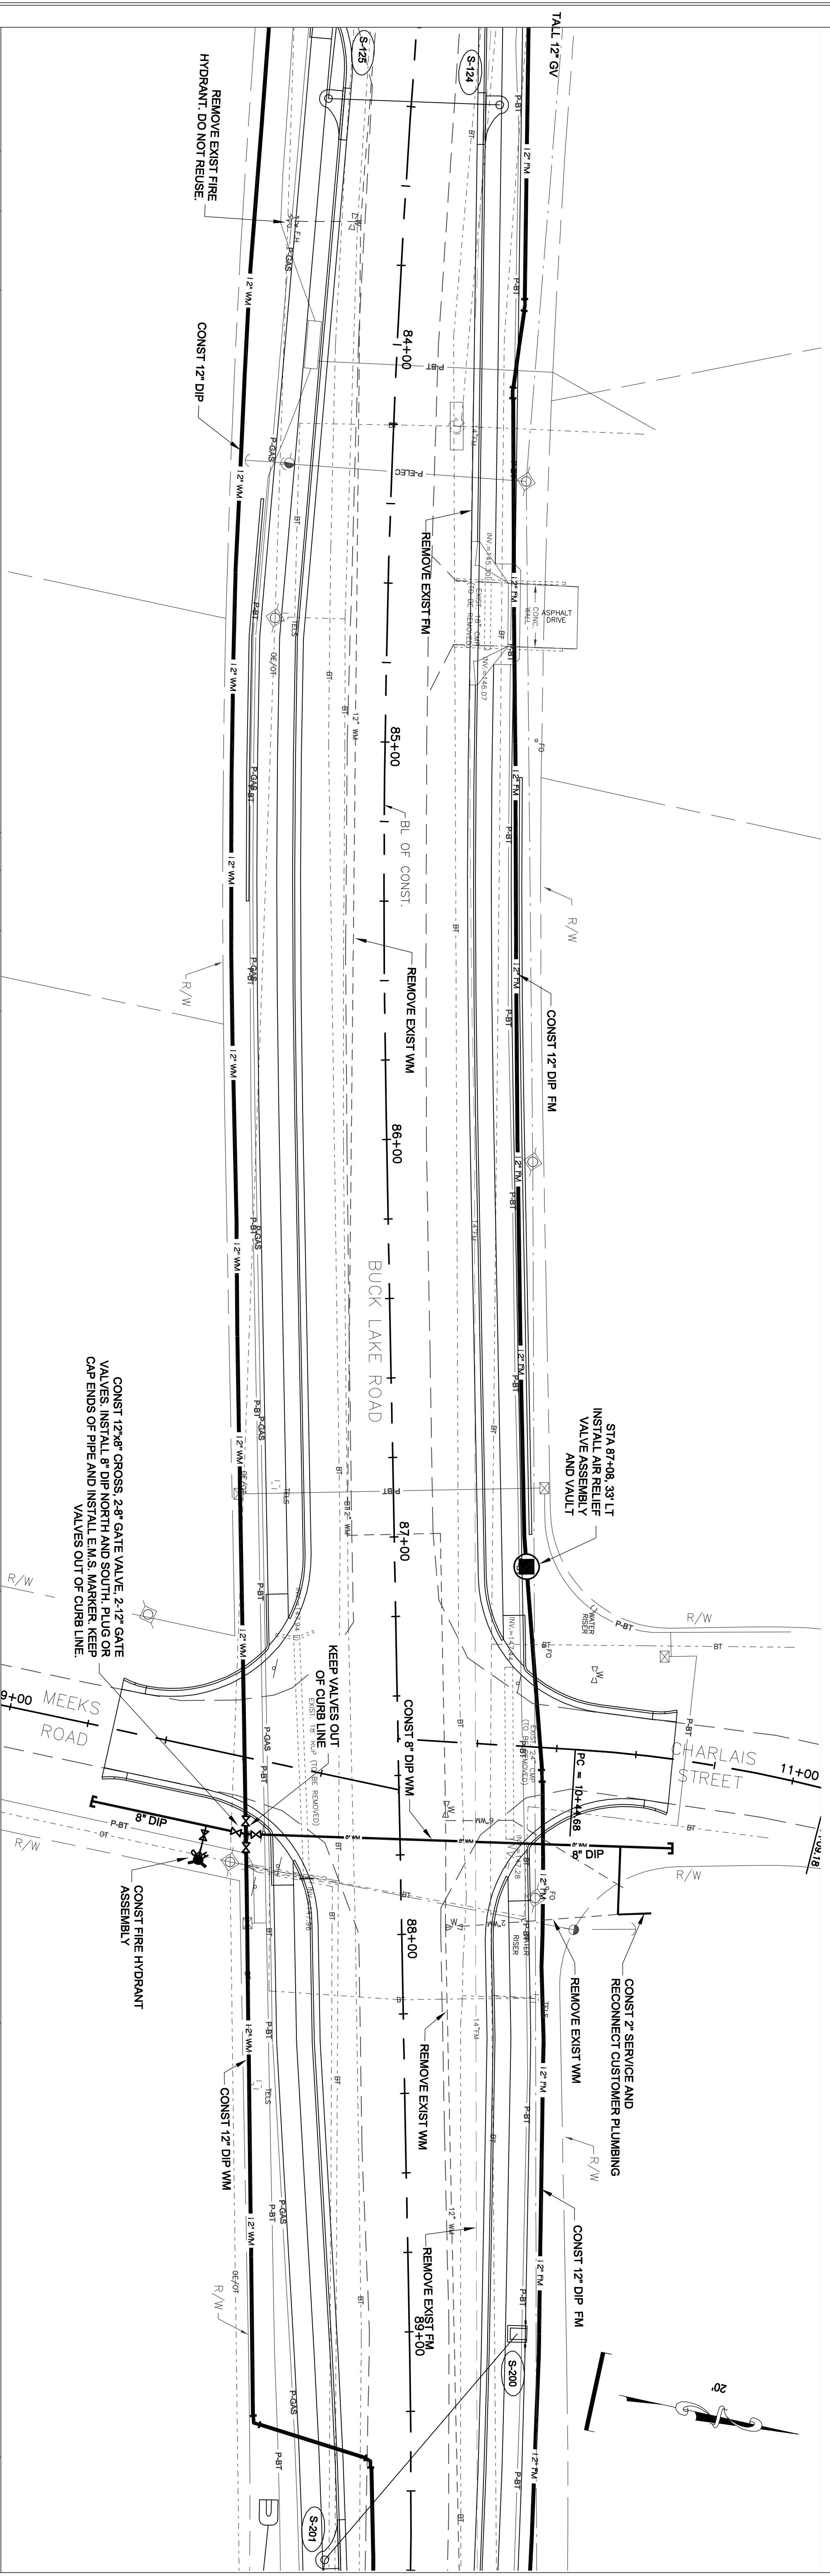

CONST 12" 6" CROSS, 2.8' GATE VALVE, 2-12" GATE VALVES, INSTALL 8" DIP NORTH AND SOUTH, PLUG OR CAP ENDS OF PIPE AND INSTALL E.M.S. MARKER, KEEP VALVES OUT OF CURB LINE.

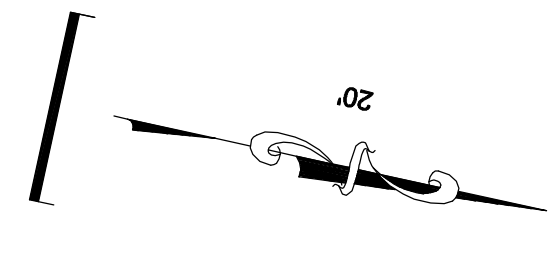

SUBMITTED BY	INITIAL	DATE	REVISIONS	NO.	BY	DATE
DESIGN BY	SGA	03/02/2010				
DRAWN BY	LB	03/03/2010				
CHECKED BY	SGA	03/08/2010				

City of Tallahassee
Your Own Utilities™
 WATER RESOURCES ENGINEERING-300 S. ADAMS ST. B-26-TALLAHASSEE, FL 32301
 Tel. (850) 991-8155

PROJECT: BUCK LAKE ROAD
SHEET TITLE: POTABLE WATER & FORCE MAIN RELOCATIONS
 STA 83+40 TO STA 89+40
SHEET: U-7